






WARNING


1. Installation should only be done by a licensed electrician
2. For indoor use only in damp or dry locations only
3. Not Suitable for wet or outdoor locations
4. Tombstones must be in good working condition with no damage prior to installation
5. LED tube must be properly seated in the tombstone to work correctly
6. Not suitable for use in emergency exits
7. Not suitable for use with dimmer

INSTRUCTIONS FOR BYPASSING BALLAST (TYPE B)




1. Disconnect power
2. Remove diffuser (if installed) and ballast cover
3. Remove existing fluorescent tubes and discard or recycle according to your local regulations
4. Cut wires leading to existing ballast
5. Rewire power for single-ended or double-ended installation according to the appropriate diagram below
6. Reinstall ballast cover
7. Install LED tubes
8. Place provided UL1958C sticker onto fixture
9. Replace diffuser (if provided)
10. Restore power

TYPICAL NON-SHUNTED TOMBSTONE

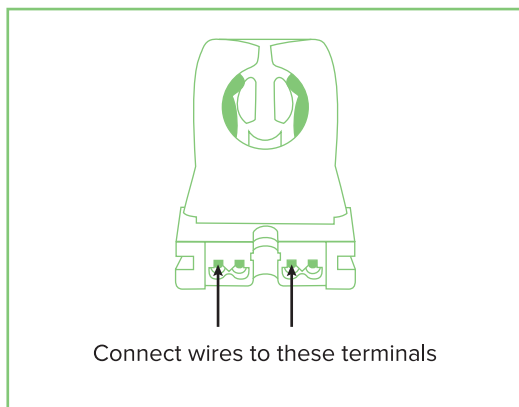


TYPICAL SHUNTED TOMBSTONES

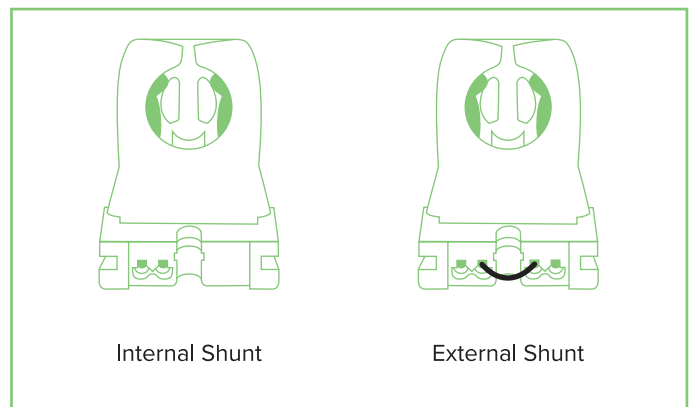

COMMON BALLAST CONFIGURATIONS

✂ - Indicates where to cut existing wires

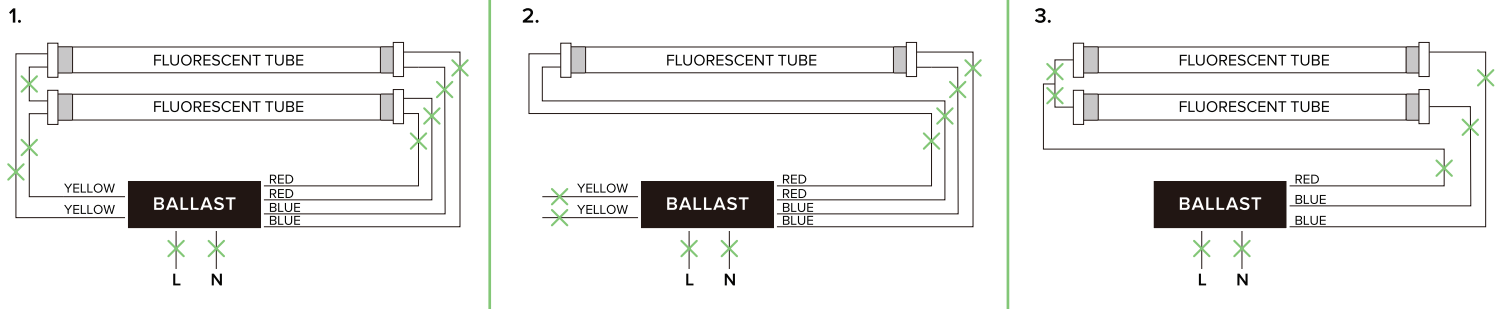


WIRING DIAGRAMS

Single-Ended Wiring - Single Lamp



Single-Ended Wiring - Multiple Lamps

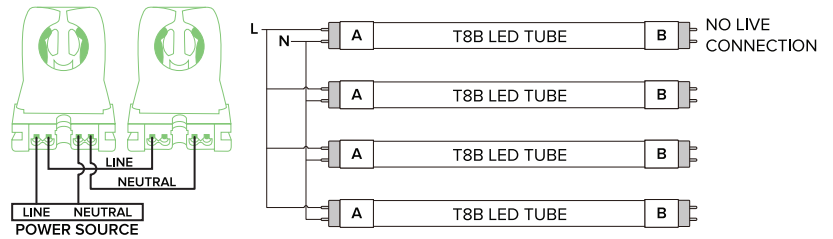

Double-Ended Wiring - Single Lamp

• SHUNTED TOMBSTONES




• NON-SHUNTED TOMBSTONES



Double-Ended Wiring - Multiple Lamps

• SHUNTED TOMBSTONES

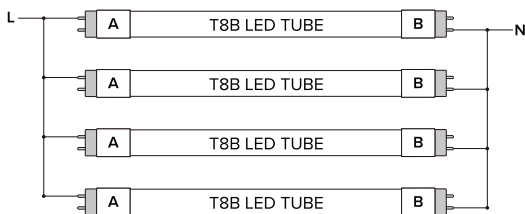

• NON-SHUNTED TOMBSTONES

